



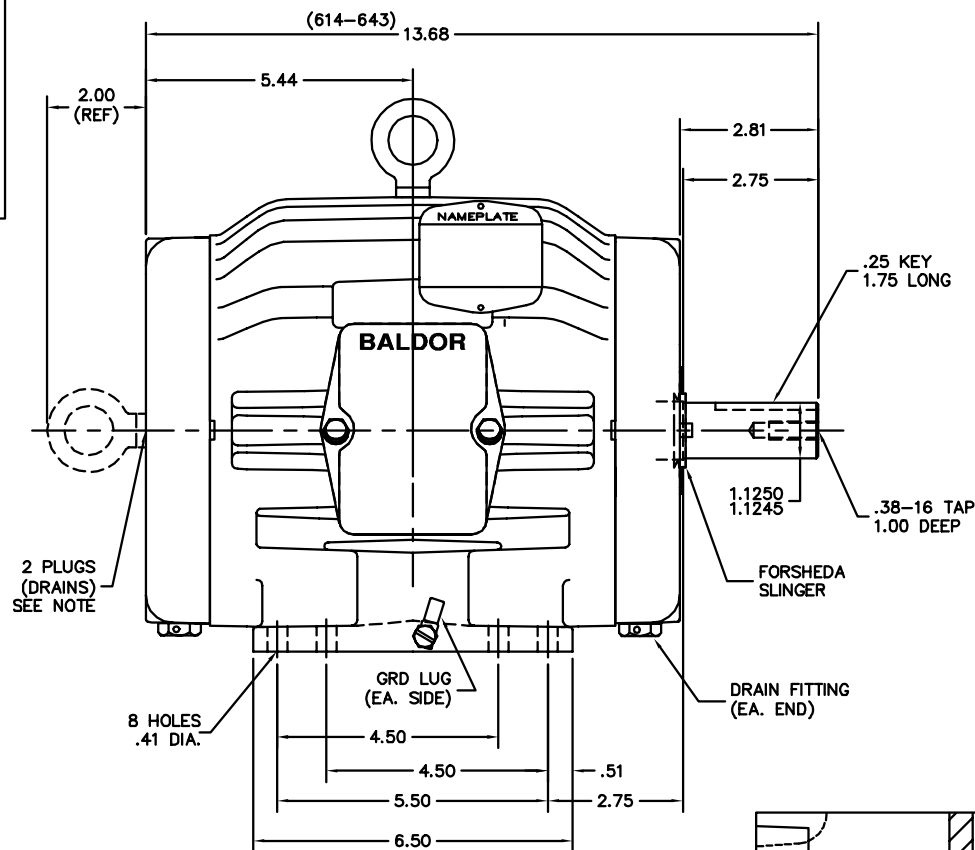


NOTE:

FOR VERTICAL SHAFT UP LIFTING
USE LOOSE EYEBOLT AND SCREW
INTO END OF SHAFT

FOR VERTICAL SHAFT DOWN
MOUNTING, REMOVE PLUGS FROM
NON-DRIVE END OF MOTOR & INSTALL
BOTH EYEBOLTS



PULLEY END DETAIL

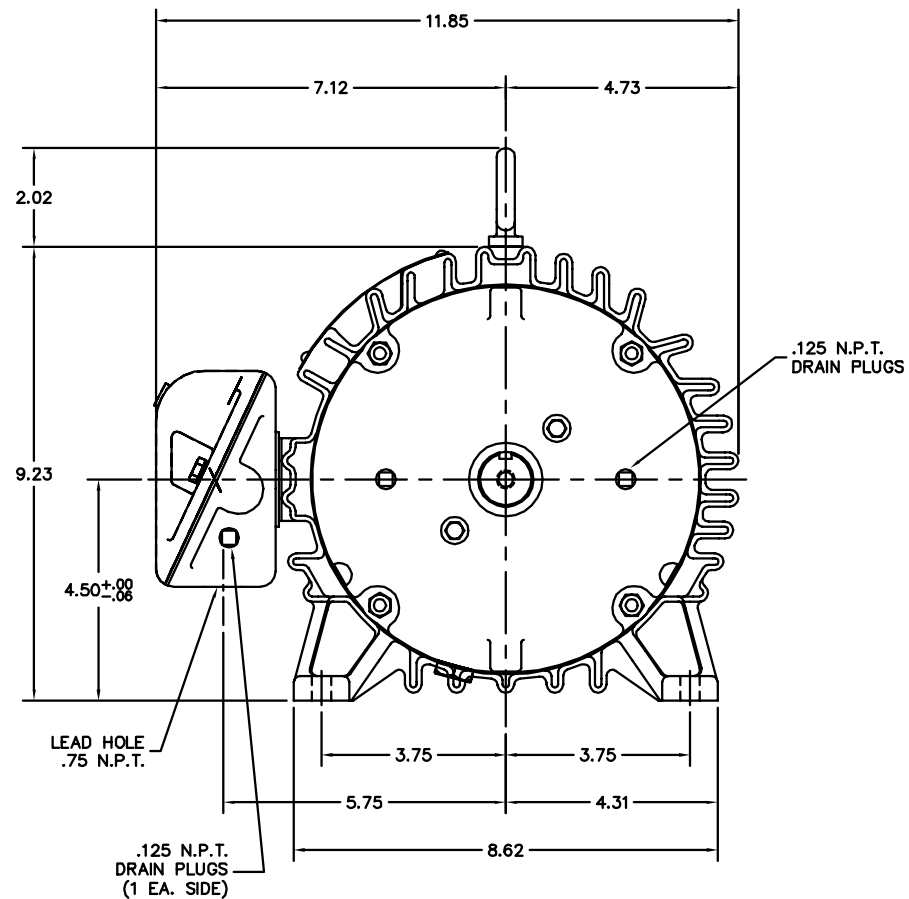

CUSTOMER IS RESPONSIBLE FOR DETERMINING THAT BALDOR'S PRODUCT WILL PERFORM SUITABLY IN THE INTENDED APPLICATION.

REV. DESC: UPDATE TO 614-643

REV. LTR: B

FILE: \AAA\00091\001

MTL: -

VERSION: 02

REVISED: 01:53:15 08/02/2010

TDR: 000000537660

BY: ENSTEKO

BALDOR

HORZ 182-4T TEAO CP COOLING TOWER, VERT LIFT, SEALED BRGS

SH 1 of 1