


DUTY MASTER ALTERNATING CURRENT MOTORS
SQUIREL-CAGE INDUCTION
CAST IRON CONSTRUCTION
ENCLOSURE: TOTALLY ENCLOSED
MOUNTING: FOOT
COOLING: FAN COOLED

FRAMES 250T THRU 440T

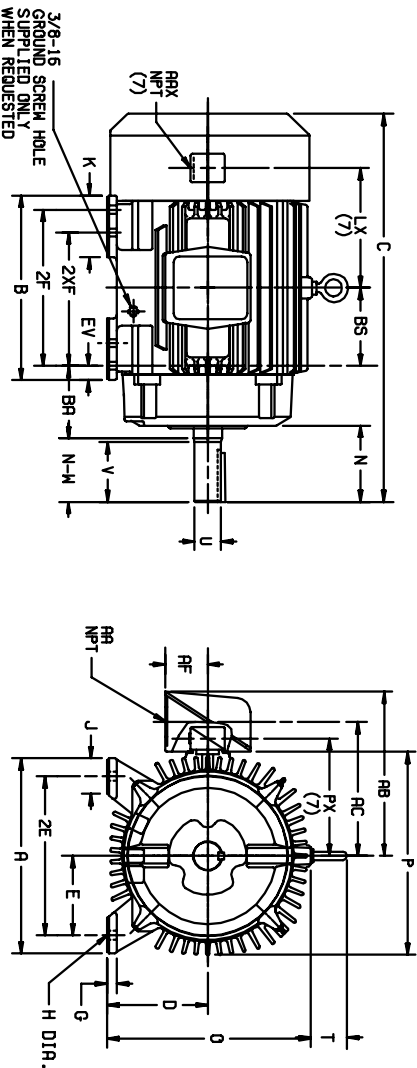

DIMENSIONS ARE IN INCHES; SEE SHEET 2 FOR DIMENSIONS IN MILLIMETERS

FRAME	A	D(2)	E	G	H	J	K	O	P	T	AA	AB	AC	AF	AX	IX (7)	PX (7)	BA	EY
254T-256T	12.50	6.25	5.00	.75	.56	2.50	---	13.25	13.25	2.44	1-1/4	10.81	8.81	2.50	3/4	6.31	9.31	4.25	1.00
284T-286T	13.75	7.00	5.50	.75	.56	2.50	---	14.75	14.88	2.44	1-1/2	12.62	10.19	3.00	3/4	6.88	10.50	4.75	1.00
324T-326T	15.50	8.00	6.25	.88	.69	2.75	4.50	16.69	17.00	2.44	2	15.44	11.69	3.62	3/4	8.00	10.50	5.25	1.38
364T-365T	17.00	9.00	7.00	.88	.69	2.75	3.88	18.50	19.50	2.94	3	18.00	13.81	4.12	3/4	8.36	11.62	5.88	1.38
404T-405T	19.00	10.00	8.00	1.12	.81	3.25	4.62	21.31	22.50	2.94	3	19.25	15.06	4.12	3/4	9.62	14.44	6.62	1.13
444T-445T	21.00	11.00	9.00	1.12	.81	3.25	5.25	23.38	25.25	3.25	3	22.19	17.44	6.00	3/4	11.12	15.25	7.50	1.25

FRAME	A	D(2)	E	G	H	J	K	O	P	T	AA	AB	AC	AF	AX	IX (7)	PX (7)	BA	EY
254T	24.56	5.00	12.00	---	8.25	4.12	4.12	4.00	1.625	3.75	.375	2.88	.335	---	---	---	---	---	---
256T	24.56	5.00	12.00	---	8.25	4.12	4.12	4.00	1.625	3.75	.375	2.88	.345	---	---	---	---	---	---
284T	27.44	5.50	13.00	---	9.50	5.00	4.62	1.875	4.38	.500	3.25	.475	---	---	---	---	---	---	---
284T	26.06	5.50	13.00	---	9.50	3.62	3.25	1.625	3.00	.375	1.88	.475	---	---	---	---	---	---	---
286T	27.44	5.50	13.00	---	9.50	5.00	4.62	1.875	4.38	.500	3.25	.490	---	---	---	---	---	---	---
286T	26.06	5.50	13.00	---	9.50	3.62	3.25	1.625	3.00	.375	1.88	.490	---	---	---	---	---	---	---
324T	30.44	6.00	14.75	---	10.50	5.62	5.25	2.125	5.00	.500	3.88	.590	---	---	---	---	---	---	---
324T	28.94	6.00	14.75	---	10.50	5.62	5.25	2.125	5.00	.500	3.88	.590	---	---	---	---	---	---	---
326T	30.44	6.00	14.75	---	10.50	5.62	5.25	2.125	5.00	.500	3.88	.630	---	---	---	---	---	---	---
326T	28.94	6.00	14.75	---	10.50	5.62	5.25	2.125	5.00	.500	3.88	.630	---	---	---	---	---	---	---
326T	28.94	6.00	14.75	---	10.50	5.62	5.25	2.125	5.00	.500	3.88	.630	---	---	---	---	---	---	---
364T	33.44	6.12	15.00	---	11.25	6.25	5.88	2.375	5.62	.625	4.25	.865	---	---	---	---	---	---	---
364T	31.31	6.12	15.00	---	11.25	6.25	5.88	2.375	5.62	.625	4.25	.890	---	---	---	---	---	---	---
364T	33.44	6.12	15.00	---	11.25	6.25	5.88	2.375	5.62	.625	4.25	.890	---	---	---	---	---	---	---
365T	31.31	6.12	15.00	---	11.25	6.25	5.88	2.375	5.62	.625	4.25	.890	---	---	---	---	---	---	---
365T	31.31	6.12	15.00	---	11.25	6.25	5.88	2.375	5.62	.625	4.25	.890	---	---	---	---	---	---	---
404T	38.31	6.88	16.00	---	12.25	7.50	7.50	2.875	7.00	.750	5.62	1.220	---	---	---	---	---	---	---
404T	35.31	6.88	16.00	---	12.25	7.50	7.50	2.875	7.00	.750	5.62	1.220	---	---	---	---	---	---	---
405T	38.31	6.88	16.00	---	12.25	7.50	7.50	2.875	7.00	.750	5.62	1.261	---	---	---	---	---	---	---
405T	35.31	6.88	16.00	---	12.25	7.50	7.50	2.875	7.00	.750	5.62	1.261	---	---	---	---	---	---	---
444T	44.82	8.25	19.00	---	14.50	8.94	8.50	3.375	8.25	.875	6.88	1.670	---	---	---	---	---	---	---
444T	40.88	8.25	19.00	---	14.50	8.94	8.50	3.375	8.25	.875	6.88	1.670	---	---	---	---	---	---	---
445T	44.82	8.25	19.00	---	14.50	8.94	8.50	3.375	8.25	.875	6.88	1.680	---	---	---	---	---	---	---
445T	40.88	8.25	19.00	---	14.50	8.94	8.50	3.375	8.25	.875	6.88	1.680	---	---	---	---	---	---	---

- (1) SPECIAL DIMENSIONS APPLYING TO THIS ORDER ON THIS LINE.
- (2) "D" VARIES — 250T — 320T +.00, —.03.
360T — 440T +.00, —.06.
- (3) "U" VARIES — 1.625 AND LARGER +.000, —.0005
HP TO 1.625 DIA. +.0000, —.0001.
- (4) ALL FRAMES HAVE EIGHT MOUNTING HOLES FOR DUAL MOUNTING.
- (5) MOTOR WEIGHTS MAY VARY BY 15% DEPENDING UPON RATING.
- (6) "N-W" VARIES +.00, —.25.
- (7) AUXILIARY CONDUIT BOX SUPPLIED WHEN SPECIFIED
CONDUIT BOXES LOCATED ON OPPOSITE SIDE WHEN F-2-W-1,
W-4-W-5-W-7, OR C-1 MOUNTING IS SPECIFIED.
IF MOUNTING CLEARANCE DETAILS ARE REQUIRED, CONSULT
FACTORY.
MAXIMUM PERMISSIBLE SHAFT RUNOUT WHEN MEASURED
AT END OF STD. SHAFT EXTENSION IS .002 T.I.R. UP TO
AND INCLUDING 1.625 DIA. AND .003 T.I.R. 1.625 DIA.
TO 5 INCH DIA.

FRAME— TYPE— CERTIFIED FOR—
ORDER— ITEM— HP— RPM— PH— HZ— VOLTS—
SALES ORDER— APPROVED BY— DATE—

CUSTOMER IS RESPONSIBLE FOR DETERMINING THAT MOTOR PERFORMANCE IS SUITABLE IN THE APPLICATION.

REV. DESC: REMOVING TITLEBLOCK	VERSION: 01	TDR: 000000448517
REV. LTR: A	REVISED: 14:06:59 11/07/2007	BY: CONBPM
FILE: \RAG\00004\525		
MTL: —		



DIM SHT 250T-440T TEFC FT MTG STD T & TS SGL EXT XT